ALLEN-BRADLEY



0–24V Contact Output Module Cat. No. 1771–OZL

Installation Data

To The Installer

This document provides information on:

- important pre-installation considerations
- power supply requirements
- installing the module
- connecting the wiring
- using the indicators on the module for troubleshooting
- module specifications

Pre-installation Considerations

This module does not contain surge limiting circuitry. Use this module for switching resistive loads only. It is not recommended for inductive or capacitive loads.

The 1771–OZL module has 8 Form A relays. The outputs are arranged in 4 groups of 2, each group with its own common. Each output is electrically isolated from module logic circuitry. The module can simultaneously switch all 8 outputs to separate loads, each conducting a maximum load of 100mA continuously, at rated power. Ac loads switched by the modules should have a power factor (PF) of 1.0.

Maximum interconnect cable length for these modules is 1000 ft. (304.8 meters).

Power Supply Requirements The controller or I/O chassis power supply, connected through the backplane of the I/O chassis, powers the logic circuitry of the contact output modules. This supply also provides the necessary power to energize the coils of the module relays. Each energized relay draws 37mA from this supply. The maximum current drawn from this supply when all coils are energized is 420mA.

Installing the Module

In this section we tell you how to initially handle the module, key your I/O chassis, install your module and make your wiring connections.

Initial Handling Procedures



ATTENTION: Remove power from the 1771 I/O chassis backplane and wiring arm before removing or installing an I/O module.

- Failure to remove power from the backplane or wiring arm could cause module damage, degradation of performance, or injury.
- Failure to remove power from the backplane could cause injury or equipment damage due to possible unexpected operation.

The contact output module contains components which can be damaged by electrostatic discharge. Each module is shipped in an electrostatic shielded bag for protection. Follow the handling procedures outlined below to guard against damage to your module.

- Touch a grounded object to discharge yourself before handling the module.
- Do not touch the backplane connector or connector pins.
- If you configure or replace internal components, do not touch other circuit components inside the module. If available, use a static–safe work station.
- When not in use, keep the module in its static–free shield bag.

Keying the I/O Chassis

Use the plastic keying bands, shipped with each I/O chassis, to key your I/O slots to accept only this type of module. Place the keying bands on the chassis backplane between:

- 6 and 8
- 16 and 18

Slots on the rear edge of the circuit board are matched to these slots to allow insertion of this type of module. You can key any connector in an I/O chassis to receive this module except for the leftmost connector reserved for adapter or processor modules.

Inserting the Module Into the Chassis

- **1.** Position the module so that the circuit board on the rear of the module lines up with the top and bottom card guides in the chassis.
- 2. Slide the module into the chassis.
- 3. Press firmly to seat the module in the chassis backplane connector.
- **4.** Swing the module locking latch down into place over the front edge of the module.

Connecting Wiring to the Module


You make connections to the module through the field wiring arm cat. no. 1771–WD. The arm pivots on the I/O chassis to connect with terminals on the front of the module and acts as a terminal strip. The wiring arm allows the module to be removed from the chassis without disconnecting wiring.

- **1.** Make certain all power is removed from the module before making wiring connections.
- 2. Swing the wiring arm up into position on the front of the module. The locking tab on the module will secure it into place.
- **3.** Make your connections to the field wiring arm as shown in . (Use the label on the front of the wiring arm to identify your wiring.)




ATTENTION: The field wiring arm terminal identification number is not the same as the number of the bit which controls that output.



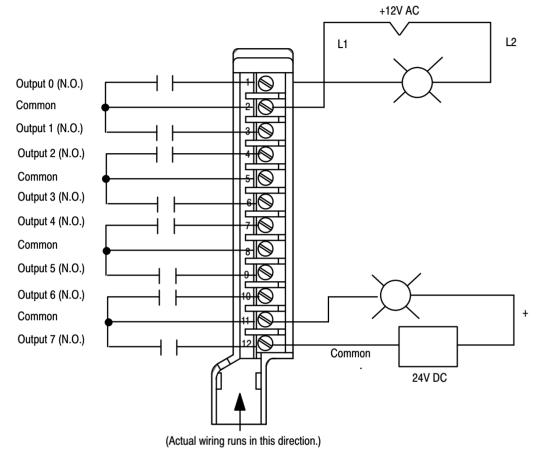

10568-I



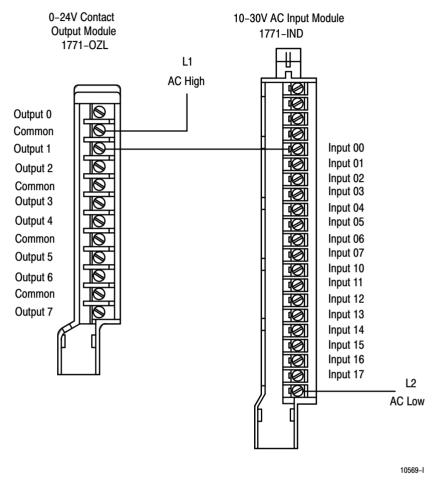



ATTENTION: Do not attempt to increase load current or wattage capability beyond the rating by connecting two or more outputs in parallel. The slightest variation in output relay switching time may cause one set of contacts to switch the total load current.

Interpreting the Status Indicators

The module has 8 status indicators on the module front plate. These indicators represent the control status of the output relays. Each indicator is lit when its corresponding relay is energized.

Figure 3 Status Indicators

Specifications

Outputs per Module	8 (4 groups of 2)
Module Location	1771 Series A or B I/O chassis
Contact Configuration	8 Form A (N.O.)
Voltage Rating	0-24V AC RMS; 0-24V DC
Current Rating ²	100mA per output (maximum) ¹
Surge Current	100mA maximum per output (at rated power)
Power Rating	DC: 2.4W per output (resistive) AC (suppressed) ^{1:} 2.4W per output (resistive)
Minimum Contact Load	DC: 10mA @ 24V; AC: 10mA @ 24V
Operate/Release Time	1msec maximum
Bounce Time	1msec maximum
Switching Frequency	10Hz maximum
Signal Delay	1.0ms on or off
Isolation Voltage	1000V open contacts; 1500V coil to contacts
Power Dissipation	2.2 Watts (max.), 2 Watts (min.)
Thermal Dissipation	7.6 BTU/hr (max.), 6.9 BTU/hr (min.)
Backplane Current	420mA maximum
Conductors Wire Size Category	14 gage stranded maximum 3/64 inch insulation maximum 1 ³
Environmental Conditions Operating Temperature Storage Temperature Relative Humidity	0 to 60°C (32 to 140°F) -40 to 85°C (-40 to 185°F) 5 to 95% (without condensation)
Keying	Between 6 and 8 Between 16 and 18
Field Wiring Arm	1771-WD

¹ Surge limiting circuitry is not provided in the module. For reliable operation, the user must

ensure that surges do not exceed either the voltage or current rating of the module.

 2 Spikes, peaks and surges must be within the power rating. Resistive loads only. AC or DC power = 2.4W max.

³ Refer to publication 1770–4.1, Programmable Controller Wiring and Grounding Guidelines.



As a subsidiary of Rockwell International, one of the world's largest technology companies — Allen-Bradley meets today's challenges of industrial automation with over 85 years of practical plant-floor experience. More than 11,000 employees throughout the world design, manufacture and apply a wide range of control and automation products and supporting services to help our customers continuously improve quality, productivity and time to market. These products and services not only control individual machines but integrate the manufacturing process, while providing access to vital plant floor data that can be used to support decision-making throughout the enterprise.

With offices in major cities worldwide.

WORLD HEADQUARTERS Allen-Bradley 1201 South Second Street Milwaukee, WI 53204 USA Tel: (1) 414 382-2000 Telex: 43 11 016 FAX: (1) 414 382-4444

EUROPE/MIDDLE EAST/AFRICA HEADQUARTERS Allen-Bradley Europe B.V. Amsterdamseweg 15 1422 AC Uithoorn The Netherlands Tel: (31) 2975/43500 Telex: (844) 18042 FAX: (31) 2975/60222

ASIA/PACIFIC HEADQUARTERS

Allen-Bradley (Hong Kong) Limited Room 1006, Block B, Sea View Estate 28 Watson Road Hong Kong Tel: (852) 887-4788 Telex: (780) 64347 FAX: (852) 510-9436 CANADA HEADQUARTERS Allen-Bradley Canada Limited 135 Dundas Street Cambridge, Ontario N1R 5X1 Canada Tel: (1) 519 623-1810 FAX: (1) 519 623-8930

LATIN AMERICA HEADQUARTERS

Allen-Bradley 1201 South Second Street Milwaukee, WI 53204 USA Tel: (1) 414 382-2000 Telex: 43 11 016 FAX: (1) 414 382-2400